



Cable ID: NEX1 UTP CAT.6 5M


Test Summary: PASS

Date / Time: 06/17/2006 11:23:06am
Headroom: 2.4 dB (NEXT 36-45)
Test Limit: TIA C6 5 m Patch Cord
 Cable Type: UTP 100 Ohm Cat 6
 Fault Anomaly Threshold: 15%


Operator: VINCENT
 Software Version: 1.921
 Limits Version: 5.13C
 NVP: 68.9%
 Shield Test: N/A

Model: DSP-4300
 Main S/N: 8837001
 Remote S/N: 8837001
 Main Adapter: LIA 006
 Remote Adapter: LIA 006


Wire Map	1 2 3 4 5 6 7 8 S
PASS	
	1 2 3 4 5 6 7 8



Length (ft)	[Pair 12]	18
Prop. Delay (ns)	[Pair 36]	28
Delay Skew (ns)	[Pair 36]	1
Resistance (ohms)		N/A

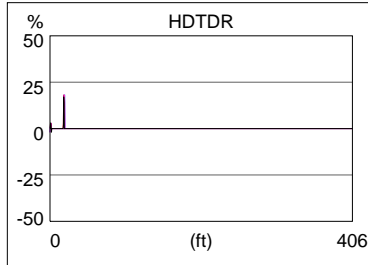

	Worst Case Margin		Worst Case Value	
	MAIN	SR	MAIN	SR
PASS				
Worst Pair	36-45		36-45	
NEXT (dB)	2.4		2.4	
Freq. (MHz)	237.0		237.0	
Limit (dB)	38.5		38.5	

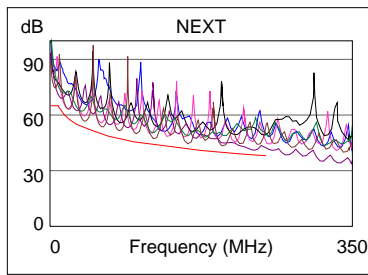

	Worst Case Margin		Worst Case Value	
	MAIN	SR	MAIN	SR
PASS				
Worst Pair	78		78	
RL (dB)	1.4		2.6	
Freq. (MHz)	9.9		176.0	
Limit (dB)	22.8		15.5	

